


PLAN VIEW

- OPTIONS:
 ● FLANGE CONNECTIONS
 ● ELEVATED STAND
 ● LADDERS

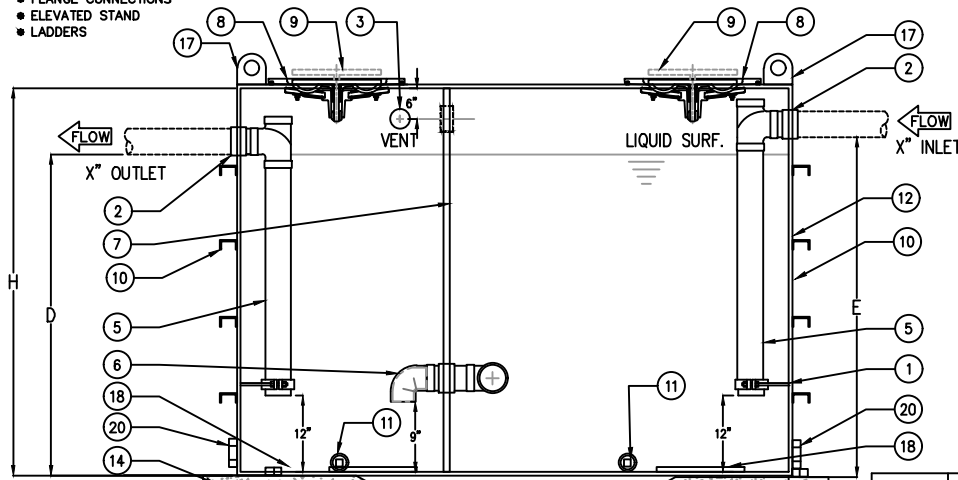

ELEVATION

6" THK CONCRETE EQUIPMENT PAD (BY CONTRACTOR)

KEYED NOTES		
MARK	QTY	DESCRIPTION
1	1	PREFABRICATED 304 STAINLESS STEEL TANK ASSEMBLY
2	2	4" FPT CONNECTION
3	1	3" FPT VENT CONNECTION
4	1	3" BAFFLE VENT SLEEVE
5	2	4" SCH 40 PVC PIPING
6	2	6" SCH 40 PVC DOUBLE TEE MANIFOLD
7	1	BAFFLE
8	2	20" DIA MANWAY w/ GAS-TIGHT, ACCESS COVER
9	2	MANWAY LOCKING HANDLE
10	-	C4x5.4 STRUCTURAL REINFORCING (TYP)
11	2	2" FPT DRAIN w/ BRASS PLUG
12	1	EXTERIOR OF INTERCEPTOR LINED WITH CORROSION RESISTANT COATING
13	1	TYPICAL PIPING (BY OTHERS)
14	1	FOR FLOOR MOUNTING APPLY 1/8" BITUMASTIC & COVER WITH ROOFING FELT (BY OTHERS)
15	1	NAMEPLATE INDICATING: MFG: ParkUSA.COM 888-611-PARK www.ParkUSA.com MODEL: GTS-XXXX DATE MANUFACTURED
16	1	2" FULL COUPLING NPT w/ CAP
17	4	LIFTING LUGS
18	2	STRIKER PLATES 32" SQ X 3/16" SS304
19	2	3/4" FULL COUPLING FOR OPTIONAL WASH SYSTEM
20	4	SEISMIC ANCHOR

MODEL	TANK SIZE	L	W	H	D	E	EMPTY WT.-LBS	GROSS WT.-LBS
GTS-500	500 GAL	6'-4"	3'-6"	4'-0"	3'-0"	3'-3"	1,400	4,200
GTS-750	750 GAL	8'-4"	4'-0"	4'-0"	3'-0"	3'-3"	1,800	6,300
GTS-1000	1000 GAL	9'-0"	5'-0"	4'-0"	3'-0"	3'-3"	2,100	8,500
GTS-1500	1400 GAL	10'-4"	5'-0"	5'-0"	4'-0"	4'-3"	2,500	12,900
GTS-2000	2000 GAL	11'-0"	6'-0"	5'-0"	4'-0"	4'-3"	2,900	16,500
GTS-2500	2500 GAL	11'-4"	6'-0"	6'-0"	5'-0"	5'-3"	3,300	21,300
GTS-3000	3000 GAL	13'-2"	6'-0"	6'-0"	5'-0"	5'-3"	3,600	24,700
GTS-3500	3500 GAL	14'-0"	7'-0"	6'-0"	5'-0"	5'-3"	4,200	30,600
GTS-4000	4000 GAL	15'-0"	7'-0"	6'-0"	5'-0"	5'-3"	4,400	37,900
GTS-5000	5000 GAL	16'-0"	7'-0"	7'-0"	6'-0"	6'-3"	6,400	41,600
GTS-6000	6000 GAL	20'-0"	8'-0"	6'-0"	5'-0"	5'-3"	6,900	51,500
GTS-7000	7000 GAL	20'-0"	8'-0"	7'-0"	6'-0"	6'-3"	9,300	68,100
GTS-8000	8000 GAL	22'-0"	8'-0"	7'-0"	6'-0"	6'-3"	7,200	79,800
GTS-9000	9000 GAL	25'-0"	8'-0"	7'-0"	6'-0"	6'-3"	8,000	85,000
GTS-10000	10000 GAL	28'-0"	8'-0"	7'-0"	6'-0"	6'-3"	9,200	94,400

- UNITS UP TO 6000 GALLONS ARE UPC LISTED
- OTHER SIZES ARE AVAILABLE. CONTACT US FOR MORE INFORMATION.

GREASE INTERCEPTOR SPECIFICATIONS - MODEL GTS

A: GENERAL:

A GREASE INTERCEPTOR SHALL BE PROVIDED IN INSTALLED AS INDICATED ON PLANS. SYSTEM SHALL BE PARKUSA GREASETROOPER™ MODEL GTS [XXX] 888-611-PARK WWW.PARKUSA.COM, OR EQUAL. THE SYSTEM SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.


- GREASE INTERCEPTOR DESIGN SHALL CONFORM TO CRITERIA SET FORTH BY THE INTERNATIONAL ASSOCIATION OF PLUMBING AND MECHANICAL OFFICIALS (IAPMO), UPC LISTED (UNIFORM PLUMBING CODE), ASTM C1613-07, EPA, AND ALL OTHER GOVERNING STATE AND LOCAL CODE REQUIREMENTS.
- THE GREASE INTERCEPTOR SHALL BE PROVIDED WITH INSTALLATION, OPERATION & MAINTENANCE MANUALS THAT CONTAIN CLEAR AND CONCISE DESCRIPTIONS.

B: MATERIALS:

- THE INTERCEPTOR SHALL BE OF THE SIZE AND CONFIGURATION AS SHOWN ON THE PLANS AS MANUFACTURED BY PARKUSA OR EQUAL. TANK SHALL BE CONSTRUCTED IN ACCORDANCE WITH AMERICAN WELDING SOCIETY SPECIFICATIONS, WITH STRUCTURAL DESIGN IN ACCORDANCE WITH AISC LATEST ISSUE.
- THE INTERCEPTOR SHALL BE DIVIDED WITH A BAFFLE WITH TWO COMPARTMENTS.
- THE TANK SHALL INCLUDE THE FOLLOWING AND SUCH OTHER ITEMS DETAILED ON THE PLANS.
 - TOP - 3/16" ASTM A666 STAINLESS STEEL PLATE MINIMUM.
 - SHELL OR SIDES - 3/16" ASTM A666 STAINLESS STEEL PLATE MINIMUM.
 - BOTTOM - 1/4" ASTM A666 STAINLESS STEEL PLATE MINIMUM.
 - 150 PSI ANSI FORGED 304 STAINLESS STEEL HALF COUPLINGS (AS REQUIRED FOR TANK CONNECTIONS).
 - MINIMUM OF TWO MANWAYS WITH FLANGE, GASKET, & QUICK-DISCONNECT FASTENERS ON TOP OF TANK. THE MANWAY COVER, FLANGE, & FASTENERS SHALL BE CONSTRUCTED OF TYPE 304 STAINLESS STEEL.
 - INTERNAL MANIFOLD PIPING CONSISTING OF MINIMUM 6" SDR 35 PVC.

C: PROTECTIVE COATINGS:

- THE MANUFACTURER SHALL BE A CERTIFIED APPLICATOR OF ENGINEERED COATINGS.
- PAINTING MANUAL, VOLUME 1, GOOD PAINTING PRACTICE. THESE TECHNIQUES INCLUDE, BUT ARE NOT LIMITED TO, MULTIPLE PASSES OF THE SPRAY GUN, WITH EACH PASS OVERLAPPED 50%, AND 'CROSS HATCHING' SUCCESSIVE COATS OF PAINT.
- MATERIALS SHALL BE THINNED ONLY WITH THE MANUFACTURER'S RECOMMENDED THINNERS AND SHALL BE THINNED ONLY THE AMOUNT REQUIRED ADJUST THE VISCOSITY FOR TEMPERATURE VARIATIONS, PROPER ATOMIZATION AND FLOW-OUT.
 - INTERIOR SURFACES - FACTORY MILL FINISH
 - EXTERIOR SURFACES
 - SURFACE PREPARATION: PER SSPC-SP10 NEAR WHITE BLAST CLEAN, WITH 1.5-2.0 MIL/ 5 MICRON DENSE, SHARP ANCHOR PROFILE FREE PEENING, AS MEASURED BY ASTM D 4417.
 - PRIME/FINISH COAT: CARBOLINE - CARBOGUARD 890 EPOXY PRIMER @ 6 MIL DFT WITH CARBOTHAN 34 HG EPOXY FINISH @ 3 MIL DFT.
 - BOTTOM OF TANK COATING: CARBOLINE - BITUMASTIC 300M HIGH BUILD COAL TAR EPOXY WITH 20 MIL DRY FILM THICKNESS.



© ParkUSA. ALL RIGHTS RESERVED.



GREASE INTERCEPTOR

(ABOVE GROUND) MODEL GTS-AG 500 THRU 10,000 GALLONS

PM	PC	DRN	ENG	DWG. NO.	REV.
				GTS-AG-WA	A
DATE	4/24				

LAST MODIFIED BY YOU ON 4/18/2024 4:03 PM. LAST PLOTTED ON 4/18/2024 4:04 PM BY VLT. FILE NAME: GTS-AG-WA.DWG